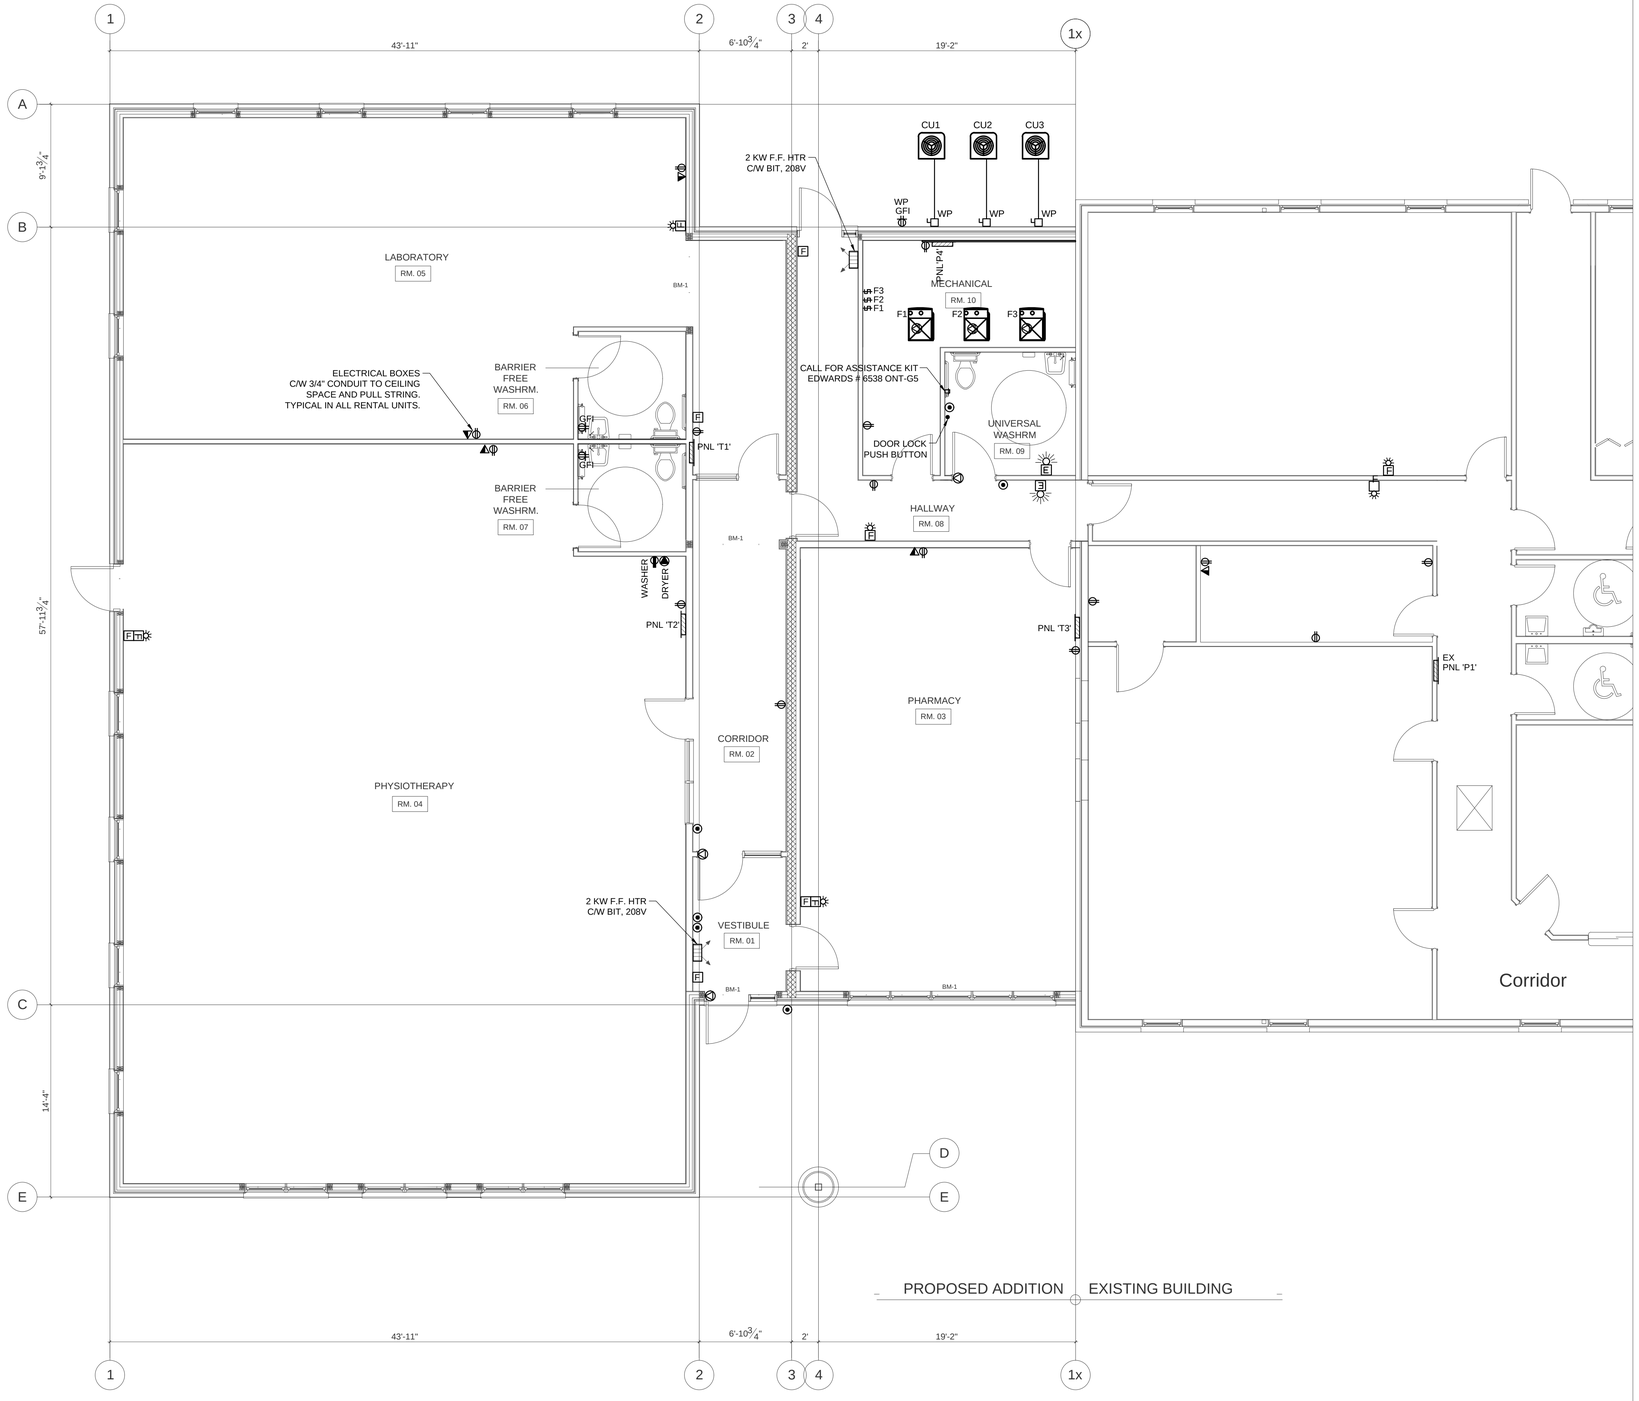


VOLTS 120/208 | PANEL-PANNEAU ** NEW TENANT PANEL 'T#' | TYPE
PHASE 3 | LOCATION-EMPLACEMENT | MAINS-CONDUITE ____ AMPS.
WIRE-COND. | FED FROM-DERIVE DE | ENTER AT-ENTREE ____ MTG-INST

| 200 A DESIGNATION | CIR NO | BKR DISJ. | A B C | BKR DISJ. | CIR NO | DESIGNATION |
|---|---|---|---|---|---|---|
| SAPRE | 1 | 15 | | 15 | 2 | LIGHTS |
| SAPRE | 3 | 15 | | 15 | 4 | LIGHTS |
| RECECEPTACLES | 5 | 15 | | 15 | 6 | FURNACE |
| RECECEPTACLES | 7 | 15 | | 15 | 8 | |
| | 9 | | | | 10 | |
| | 11 | | -- | | 12 | CONDENSING UNIT |
| | 13 | | | | 14 | |
| | 15 | | | | 16 | |
| | 17 | | | | 18 | |
| | 19 | | | | 20 | |
| | 21 | | | | 22 | |
| | 23 | | | | 24 | |
| | 25 | | | | 26 | |
| | 27 | | | | 28 | |
| | 29 | | | | 30 | |
| | 31 | | | | 32 | |
| | 33 | | | | 34 | |
| | 35 | | | | 36 | |
| | 37 | | | | 38 | |
| | 39 | | | | 40 | |
| | 41 | | | | 42 | |

Ø "A" TOTAL:
Ø "A" TOTAL:
Ø "A" TOTAL:

TOTAL LOAD ____ KW. ____ AMP. FEEDER-AETÈRE
CHARGE TOTALE

** TENANT PANELS T1, T2, T3 C/W MAIN BREAKER

VOLTS 120/208 | PANEL-PANNEAU * ** NEW PANEL 'P4' | TYPE
PHASE 3 | LOCATION-EMPLACEMENT | MAINS-CONDUITE ____ AMPS.
WIRE-COND. | FED FROM-DERIVE DE | ENTER AT-ENTREE ____ MTG-INST

| 200 A DESIGNATION | CIR NO | BKR DISJ. | A B C | BKR DISJ. | CIR NO | DESIGNATION |
|---|---|---|---|---|---|---|
| EMERG. LIGHTS & EXIT SIGNS | 1 | 15 | | 15 | 2 | LIGHTS |
| EXHAUST FANS | 3 | 15 | | 15 | 4 | LIGHTS |
| RECECEPTACLES | 5 | 15 | | 15 | 6 | DOOR OPENERS |
| RECECEPTACLES | 7 | 15 | | 15 | 8 | UNIVERSAL WASHROOM |
| | 9 | | | | 10 | |
| | 11 | | | 15 | 12 | FF HEATER |
| | 13 | | | | 14 | |
| | 15 | | | 15 | 16 | FF HEATER |
| | 17 | | | | 18 | |
| | 19 | | | | 20 | |
| | 21 | | | | 22 | |
| | 23 | | | | 24 | |
| | 25 | | | | 26 | |
| | 27 | | | | 28 | |
| | 29 | | | | 30 | |
| | 31 | | | | 32 | |
| | 33 | | | | 34 | |
| | 35 | | | | 36 | |
| | 37 | | | | 38 | |
| | 39 | | | | 40 | |
| | 41 | | | | 42 | |

Ø "A" TOTAL:
Ø "A" TOTAL:
Ø "A" TOTAL:

TOTAL LOAD ____ KW. ____ AMP. FEEDER-AETÈRE
CHARGE TOTALE

* PUBLIC PANEL FOR THE EXTENSION C/W MAIN BREAKER

| NO. | DATE | REVISION | NAME |
|---|---|---|---|
| 1 | SEPT. 26, 2018 | BUILDING PERMIT | MY |


M&E ENGINEERING
1436868 ONTARIO LTD.
205 Kincardine Drive, Kanata, Ontario, K2V1C5
Tel: 613-836-3420 Fax: 613-836-5957



THIS DRAWING IS THE SOLE PROPERTY OF M & E ENGINEERING. REPRODUCTION IS NOT PERMITTED


PROFESSIONAL STAMP: LICENSED PROFESSIONAL ENGINEER M. YAZDANI SEPT 26, 2018 PROVINCE OF ONTARIO

NORTH

PROJECT
PETAWAWA CENTENNIAL FAMILY HEALTH CENTRE
154 CIVIC CENTRE RD., PETAWAWA, ON

DRAWING
ELECTRICAL LAYOUT

PROJECT NUMBER

CHECKED BY MY | DESIGNED BY MY
DRAWN BY FH | SCALE 3/16" = 1'-0"
DATE
REVISION | DRAWING NUMBER E-2